

14001 Surface Infrastructure Restoration for Utility Cuts

Index

14001-1	Request to Cut City of Saskatoon Surface Infrastructure	2
14001-2	Cost Schedule for Work Performed by City Forces	2
2.1	Paved Streets and Paved Lanes	2
2.2	Costs for Repair of Concrete Sidewalk and Curb	4
2.3	Costs for Repair of Gravel Lanes	4
2.4	Costs for Repair of Sod and Grass Areas	4
2.5	Costs for Paving Stones in Business Improvement Districts	4
14001-3	Specifications for Work Performed by External Corporation or Contractor	5
3.1	Paved Streets and Paved Lanes	5
3.2	Non-Paved Lanes	11
3.3	Shallow Buried Utilities in Parks and Boulevards	11
3.4	Utility Cuts on Unfinished Paved Road at Base Gravel Stage	12
3.5	Utility Cuts in Areas Graded But No Roadway Structure in Place	12
14001-4	Utility or Contractor Construction	13
14001-5	Deep Buried Utilities (i.e. Water and/or Sewer)	13

Tables

Table 1: Cold Mix Asphalt Temporary Patch Charge Rates (Charged from November 1 st until March 31 st).....	2
Table 2: Maintenance Fee Schedule (Applies to all cuts including gravel or cold mix). ..	2
Table 3: Hot Mix Asphalt Repair Charge Rates.....	3

14001-1 Request to Cut City of Saskatoon Surface Infrastructure

Seventy-two (72) hours prior to cuts in the City of Saskatoon Right of Way the “Utility Cut Request Form” must be completed at www.saskatoon.ca/utilitycuts

City of Saskatoon Surface Infrastructure applies to Cuts of the following: Paved Streets and Lanes, Concrete Sidewalk and Curbs, Gravel Lanes, Sod and Grass Areas.

14001-2 Cost Schedule for Work Performed by City Forces
2.1 Paved Streets and Paved Lanes

Please be advised **of the** charges to your Corporation for patch paving streets after construction and maintenance will be as follows. Costs include all labour, equipment and material required during the preparation and repair of the cut, follow-up maintenance and repairs as required, and long term damage to the integrity of the infrastructure.

Table 1: Cold Mix Asphalt Temporary Patch Charge Rates (Charged from November 1st until March 31st).

Item	Chargeout Unit Rate
Collector	\$ 261.85 /m ²
Arterial	\$ 281.85 /m ²
Expressway	\$ 281.85 /m ²

Table 2: Maintenance Fee Schedule (Applies to all cuts including gravel or cold mix).

Week Starting	Chargeout Surcharge
After May 19 until Nov 1	\$ 78.84
November 02	\$ 1063.97
November 09	\$ 1052.88
November 16	\$ 1041.80
November 23	\$ 1030.72
November 30	\$ 1019.63
December 07	\$ 1008.55
December 14	\$ 997.47
December 21	\$ 986.38
December 28	\$ 975.31
January 04	\$ 979.84
January 11	\$ 968.57

Week Starting	Chargeout Surcharge
January 18	\$ 957.32
January 25	\$ 946.05
February 1	\$ 934.78
February 8	\$ 923.53
February 15	\$ 912.26
February 22	\$ 901.00
March 1	\$ 889.74
March 08	\$ 878.47
March 15	\$ 867.21
March 22	\$ 855.96
March 29	\$ 777.12
April 05	\$ 698.27
April 12	\$ 619.45
April 19	\$ 540.60
April 26	\$ 461.76
May 3	\$ 382.92
May 10	\$ 304.09
May 17	\$ 225.25

Table 3: Hot Mix Asphalt Repair Charge Rates

Item	Depth	Chargeout Unit Rate
Lane	Shallow ($= < 1.2\text{m}$)	\$ 109.67 /m ²
Local	Shallow ($= < 1.2\text{m}$)	\$ 116.92 /m ²
Collector	Shallow ($= < 1.2\text{m}$)	\$ 116.92 /m ²
Arterial	Shallow ($= < 1.2\text{m}$)	\$ 131.92 /m ²
Expressway	Shallow ($= < 1.2\text{m}$)	\$ 151.92 /m ²
Lane	Deep ($> 1.2\text{m}$)	\$ 130.02 /m ²
Local	Deep ($> 1.2\text{m}$)	\$ 130.02 /m ²
Collector	Deep ($> 1.2\text{m}$)	\$ 130.02 /m ²
Arterial	Deep ($> 1.2\text{m}$)	\$ 152.27 /m ²
Expressway	Deep ($> 1.2\text{m}$)	\$ 172.27 /m ²

Charges for Barricading

\$500.00 plus taxes.

Taxes

Goods and Services Tax (GST) and Provincial Sales Tax (PST) are not included in the above prices. These taxes will be added at time of billing.

2.2 Costs for Repair of Concrete Sidewalk and Curb

- Curb only - \$171.81/lineal metre
- Sidewalk only - \$203.69/square metre
- Combined sidewalk and curb - \$231.86/square metre
- Saw cutting - \$26.33/lineal metre

2.3 Costs for Repair of Gravel Lanes

- Trench Repair - \$25.10/lineal metre
- Blading Only - \$3.83/lineal metre
- For Excavations wider than one metre, a flat rate of \$60.90/square metre

2.4 Costs for Repair of Sod and Grass Areas

- Cuts with an area of 5 sq meters or less will be charged a flat rate for sod or seeding of \$260.00.
- Sod cuts with an area in excess of 5 sq meters will be charged the flat rate of: \$260.00, plus \$18.85/sq meter for every square meter over the initial 5 sq meters for sod.
- Sod cuts for chain trenching costs will be charged a flat rate of \$260.00 for 20m or less. Any cuts longer than 20m will be charged \$260.00 plus \$8.95 per linear meter.
- Seeded grass cuts with an area in excess of 5 sq meters will be charged the flat rate of \$260.00, plus \$3.85/sq meter for grass seeding.
- Base rate sodding – the cost for sod installation is \$18.85 per square meter.
- Base rate seeding – the cost for fine grading and seeding is \$4.85 per square meter.

2.5 Costs for Paving Stones in Business Improvement Districts

- Minimum \$550 for the first sq. metre;
- \$300 per sq. metre for each additional sq. metre.

Map of Business Improvement Districts



All mapping data is provided as a public service by the City of Saskatoon, however, the City makes no warranty, express or implied, as to the accuracy, merchantability or fitness of any mapping. For a complete list of the Terms of Use please refer to the following link: [Terms of Use](#)

14001-3 Specifications for Work Performed by External Corporation or Contractor

3.1 Paved Streets and Paved Lanes

3.1.1 Shallow Buried Utilities less than 1200mm depth (cut width less than 300mm)

- All pavement edges are to be saw cut by contractor.
- On paved streets, lean concrete with a maximum strength of 10.0MPa must be used from bottom of trench to bottom of existing pavement.
- Asphalt should be 75mm thick or match existing, whichever is greater.
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.

- See Plan No. 102-0007-001.

3.1.2 Shallow Buried Utilities less than 1200mm depth (cut width greater than or equal to 300mm)

Can use one of two methods:

Method One

- All pavement edges are to be saw cut by contractor.
- Non-shrink fill with a maximum strength of 0.6MPa must be used from bottom of trench to a point 200mm below the bottom of finished pavement surface.
- Place a polyethylene bond breaker between 0.6MPa and the 20MPa concrete.
- 200mm of 20MPa concrete must be used below existing asphalt.
- Asphalt should be 75mm thick or match existing whichever is greater.
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.
- All excavated material to be hauled away.
- See Plan No. 102-0007-002.

Method Two

- All pavement edges are to be saw cut by contractor.
- Utility company is to cover their utility line with concrete or compacted gravel to a depth of 400mm below top of asphalt.
- A plate tamper or vibratory roller must be used for compaction of gravel.
- Base gravel shall be placed in 150mm lifts (maximum) and compacted to 100 % of Standard Proctor Density.
- Test results must be provided. Compaction test reports can be faxed to 975-2971.
- Base gravel is to be placed to the bottom of asphalt.
- Asphalt should be 75mm thick or match existing whichever is greater.
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.
- All excavated material to be hauled away.

- If test results are less than the specified density, the contractor must excavate, re-compact and re-test to confirm density. If densities are not met, paving costs will be increased by 20% plus barricading charge.
- If tests are not provided, paving costs will be increased by 30% plus barricading charge.
- Tests shall be taken at a minimum of 50m spacing along project.
- See Plan No. 102-0007-003.

3.1.3 Shallow Buried Utilities less than 1200mm depth (cut width greater than or equal to 300mm) Winter Construction (after November 15th) on Collector or Greater Roadways

Utility cuts will not be permitted after November 15th as hot mix asphalt is not available after this date. Under special circumstances road cuts may be permitted upon approval from the City of Saskatoon. The City of Saskatoon will determine how repairs will be made if winter construction is allowed.

3.1.4 Shallow Buried Utilities less than 1200mm depth (on all cuts) Winter Construction (after November 15th) On Local Street or Paved Lanes

Can use one of three methods:

Method One

- All existing snow and ice in the general area is to be removed and trucked off site.
- All excavated material is to be hauled to an approved disposal area off site.
- The fill, base gravel shall be placed in 150mm lifts (maximum) and a compactive effort is to be made.
- The cut is to be filled with gravel to the top of asphalt.
- The Cut is left in this condition and maintained by the City of Saskatoon through the winter months. The following steps take place during the subsequent spring season:
 - The utility is to arrange with the City to schedule the placement of hot mix asphalt.
 - The temporary patch is to be removed by utility.

- If asphalt edge is not clean and straight, the utility or contractor must make a new cut leaving the trench or hole with a straight clean edge.
- If there is no temporary patch excavate gravel to bottom of asphalt or 75mm whichever is greater.
- Base gravel is to be placed to base of asphalt.
- The trench must be compacted to 100% of Standard Proctor Density.
- If test results are less than the specified density contractor must excavate, re-compact and re-test to confirm density. Paving costs will be increased by 20% plus barricading charge.
- If tests are not provided, paving costs will be increased by 30% plus barricading charge.
- Tests shall be taken at a minimum of 50m spacing along project.
- Test results must be provided. Compaction test reports can be faxed to 975-2971.
- The City of Saskatoon will place hot mix asphalt, and the utility will be charged based on summer rates. (Refer to Page 2 for Cost Schedule).
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.

Method Two

- All existing snow and ice in the general area is to be removed and trucked off site.
- All excavated material is to be hauled to an approved disposal area off site.
- The fill, base gravel shall be placed in 150mm lifts (maximum) and an effort is made to compact materials.
- The cut is to be filled with gravel to the top of asphalt.
- The Cut is left in this condition and maintained by the City of Saskatoon through the winter months. The following steps take place during the subsequent spring season:
- The utility is to arrange with the City to schedule the placement of hot mix asphalt.
- The temporary patch is to be removed by utility.
- If there is no temporary patch, excavate gravel to bottom of asphalt or 75mm whichever is greater.

- If asphalt edge is not clean and straight, the utility or contractor must make a new cut, leaving the trench or hole with a straight clean edge.
- If utility or contractor choose not to provide compaction testing then the utility or contractor must remove gravel fill.
- All excavated material is to be hauled away.
- Non-shrink fill with a maximum strength of 0.6MPa must be used from bottom of trench to a point 200mm below the bottom of finished pavement surface.
- See Plan No. 102-0007-002.
- Place a polyethylene bond breaker between 0.6MPa and the 20MPa concrete.
- Bond breaker is not required if 0.6MPa concrete has set already. If they are poured at the same time the utility or contractor must use bond breaker.
- 200mm of 20MPa concrete must be used below existing asphalt.
- The City of Saskatoon will place hot mix asphalt, and the utility will be charged based on summer rates. (Refer to Page 2 for Cost Schedule).
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.

Method Three

- All existing snow and ice in the general area is to be removed and trucked off site.
- All pavement edges are to be saw cut by contractor.
- All excavated material is to be hauled away.
- Non-shrink fill with a maximum strength of 0.6MPa must be used from bottom of trench to a point 200mm below the bottom of finished pavement surface.
- See Plan No. 102-0007-002.
- Place a polyethylene bond breaker between 0.6MPa and the 20MPa concrete.
- 200mm of 20MPa concrete must be used below existing asphalt.
- Concrete must be covered with an insulated tarp for 24 hours.
- Utility or contractor shall place gravel from 20Mpa concrete to top of asphalt. The Cut is left in this condition and maintained by the City of Saskatoon through the winter months. The following steps take place during the subsequent spring season:
- The utility is to arrange with the City to schedule the placement of hot mix asphalt.

- The temporary patch of cold mix is to be removed by the utility
- If asphalt edge is not clean and straight, the utility or contractor must make a new cut leaving the trench with a straight clean edge.
- The City of Saskatoon will place hot mix asphalt, and the utility will be charged based on summer rates. (Refer to Page 2 for Cost Schedule).
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.

3.1.5 Shallow Buried Utilities less than 1200mm depth (cut width less than 300mm) Winter Construction (after November 15th) on Collector or Greater Roadways.

- All existing snow and ice in the general area is to be removed and trucked off site.
- All pavement edges are to be saw cut if trencher does not make a smooth cut.
- All excavated material is to be hauled to an approved disposal area off site.
- Lean concrete with a maximum strength of 10.0MPa must be used from bottom of trench to bottom of finished pavement surface.
- The City of Saskatoon will temporarily patch cuts with cold mix asphalt, the patch should be 75mm thick. The utility will be charged based on summer rates. (Refer to Page 2 for Cost Schedule). The City of Saskatoon will make the decision whether cold mix asphalt patching will be required, if not the cut will be patched with gravel.
- The Cut is left in this condition and maintained by the City of Saskatoon through the winter months. The following steps take place during the subsequent spring season:
 - The utility is to arrange with the City to schedule the placement of hot mix asphalt.
 - The temporary patch is to be removed by utility.
 - If there is no temporary cold mix asphalt patch, excavate the patch gravel to bottom of asphalt or 75mm whichever is greater.
 - The City of Saskatoon will place hot mix asphalt, and the utility will be charged based on summer rates. (Refer to Page 2 for Cost Schedule).
 - If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.

- Asphalt shall be Type 2 hot mix asphalt compacted to a minimum of 97% of Marshall design density.
- See Plan No. 102-0007-001.

3.2 Non-Paved Lanes

3.2.1 Shallow Buried Utilities in Gravel lanes

- All excavated material is to be hauled to an approved disposal area off site.
- The fill base gravel shall be placed in 150mm lifts (maximum) and compacted to 95% of Standard Proctor Density at existing field moisture content.
- The surface will be graded and the construction area must be well gravelled.
- If construction areas fail the City will fix sites and bill the utility.
- See Plan no.102-0007-005.

3.2.2 Shallow Buried Utilities in Gravel Lanes Winter Construction (after November 15th)

- All existing snow and ice in the general area is to be removed and trucked off site.
- All excavated material is to be hauled to an approved disposal area off site.
- The fill base gravel shall be placed in 150mm lifts (maximum) and a compacted effort is to be made.
- The surface will be graded and the construction area must be well gravelled.
- A restoration report is to be faxed to 975-2971.
- If construction areas fail the City will fix sites and bill utility.

3.3 Shallow Buried Utilities in Parks and Boulevards

- Utility cuts should be at least 600mm from curbs or back of walks. If utility wants to place a structure in less than the minimum requirements, the utility will have to back fill the trench or hole with 2MPa non-shrink fill, to 100mm from existing topsoil.
- Trench or hole shall be filled in 150mm lifts (maximum) and compacted to 95% of Standard Proctor Density to a depth 100mm below existing topsoil.
- 100mm of topsoil must be placed over trench or hole.
- All extra cut material must be trucked away.

- Grass seed or sod must be placed over the trench or hole. The City of Saskatoon will make the decision on whether seed or sod will be used. The City will stipulate the type of grass seed to be used.
- If trench or hole sinks (within two years) the City of Saskatoon will fill the trench or hole and invoice the utility.
- In parks, the Parks Branch may require that Parks Branch do all the repairs and invoice the utility at standard rates. (Refer to Page 2 for Cost Schedule).

3.4 Utility Cuts on Unfinished Paved Road at Base Gravel Stage

- Excavate and dispose of all trench material.
- Install utility as permitted by City of Saskatoon approved layout plan.
- Backfill required to be either:
 1. Fillcrete (unshrinkable fill) full and complete all remaining trench to the underside of the installed granular subbase;
 2. Or reinstallation of native backfill material is allowed as long as a minimum trench width of 1.2 m is excavated and native backfill is installed to 98% of Maximum Standard Proctor Dry Density, (complete with independent testing results paid for by the utility or contractor);
 3. Or minimum 10 Mpa Concrete for the full depth of installed granular subbase.
- Approved granular base properly installed to replace the region of base removed.
- The City of Saskatoon will have its Roadway Contractor shape and compact the base prior to paving, the cost of which will be charged to the Utilities account. A minimum charge of \$300 will be assessed for a maximum of 125m², with an additional \$2.00 per m² above 125m².

3.5 Utility Cuts in Areas Graded But No Roadway Structure in Place

1. Fillcrete (unshrinkable fill) full and complete all remaining trench to the underside of the future subbase; the City of Saskatoon will provide grade stakes for those elevations;
2. Or reinstallation of native backfill material is allowed as long as a minimum trench width of 1.2 m is excavated and native backfill is installed to 98% of Maximum Standard Proctor Dry Density, (complete with independent testing results paid for by the utility or contractor).

14001-4 Utility or Contractor Construction

There may be occasions where it would be beneficial to both parties to have the Contractor or Corporation arrange for asphalt or concrete repairs by a private sector supplier. Prior arrangements should be made with the Roadways Manager or Superintendent. The Roadways Branch City Yards telephone number is 975-2476.


- 2 years of warranty on asphalt work by contractor.
- If work completed by a third party hired by a utility company is not satisfactory, the work will be repaired to a satisfactory state or the City of Saskatoon will make appropriate repairs and charge the utility accordingly.
- Random and scheduled inspections will be made of all work.

14001-5 Deep Buried Utilities (i.e. Water and/or Sewer)

- All pavement edges are to be saw cut by contractor or corporation.
- If pavement edge has been damaged then the edge must be moved back to make the pavement edge a sharp clean line.
- All excavated material is to be hauled away.
- On all paved streets, the Contractor or Corporation shall place granular backfill (Class I Backfill) in 300 mm lifts (maximum) over the entire width of the trench and shall compact each lift to 98% of Standard Proctor Density at existing field moisture content, using vibratory mechanical compaction equipment.
- The compacted material shall be brought up to 450 mm below the existing base of asphalt.
- The Contractor or Corporation shall then supply and place 450 mm of street base gravel flush with the original base of asphalt; the street base gravel shall be placed in 150 mm lifts (maximum) and compacted to 100% of Standard Proctor Density at existing field moisture content.
- When the backfilling process can be co-ordinated with the City Yards crew for immediate asphalt patching, the street base should be left down to the base of existing asphalt. If not the hole should be filled to top of existing asphalt with base gravel.
- Asphalt should be 75mm thick or match existing whichever is greater.
- If existing asphalt is greater than 75mm, asphalt must be placed in two lifts.
- Tests shall be taken at a minimum of 50m spacing along the project.
- Test results are required on the following materials:

- Granular base material
 - Base Gravel
- Copies of all test results must be submitted to the Technical Support Supervisor (Fax 975-2971) and to the Operations Manager (Fax 975-2500).
- If test results are less than the specified density contractor must excavate, re-compact and re-test to confirm density, if not paving costs will be increased by 20%.
- If tests are not provided, paving costs will be increased by 30%.

TYPICAL ASPHALT CUT
0 - <300mm CUT

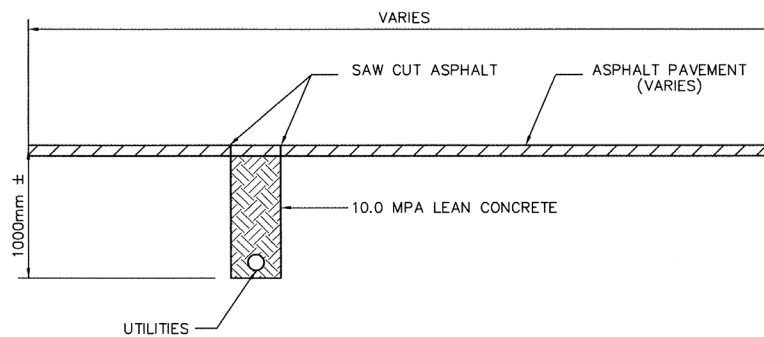


- * ASPHALT SHALL BE PLACED AT 75mm THICK OR MATCH EXISTING THICKNESS WHICHEVER IS GREATER.
- * IF EXISTING ASPHALT IS GREATER THAN 75mm, ASPHALT MUST BE PLACED IN TWO LIFTS.
- * ALL EXCAVATED MATERIAL TO BE HAULED AWAY.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

REVISIONS		 City of Saskatoon Infrastructure Services Department	CHIEF ENGINEER _____ DATE _____	
1	MRH 03-12-22		UTILITIES PLACEMENT STANDARDS	ENGINEER _____ DATE _____
2	HLO 06-01-20			
3	HLO 07-02-28			
4	REVISED DIVISION NAME 2015-DEC-01 HLO			
DRAWN BY <u>RAV</u> DATE <u>98-11-06</u>		PLAN NO. 102-0007-001r005		
SCALES : HOR. NTS _____ VERT. _____				

TYPICAL STREET
300mm - 1000mm CUT

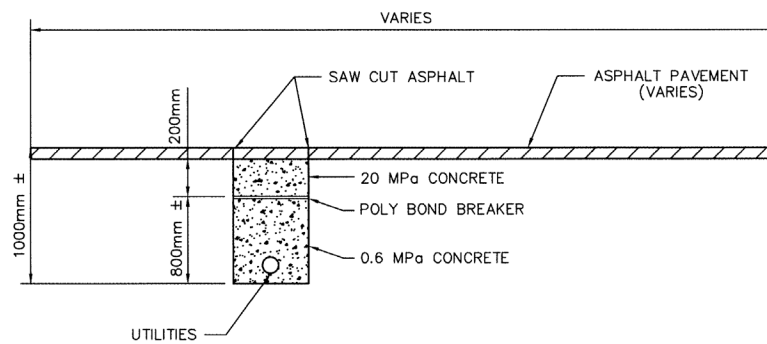


- * ASPHALT SHALL BE PLACED AT 75mm THICK OR MATCH EXISTING THICKNESS WHICHEVER IS GREATER.
- * IF EXISTING ASPHALT IS GREATER THAN 75mm, ASPHALT MUST BE PLACED IN TWO LIFTS.
- * ALL EXCAVATED MATERIAL TO BE HAULED AWAY.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

REVISIONS		 City of Saskatoon Infrastructure Services Department	CHIEF ENGINEER _____ DATE _____	
1	MRH 03-12-22		UTILITIES PLACEMENT STANDARDS	ENGINEER _____ DATE _____
2	HLO 06-01-20			
3	HLO 07-02-28			
4	REVISED DIVISION NAME 2015-DEC-01 HLO			
DRAWN BY <u>RAV</u> DATE <u>98-11-06</u>		PLAN NO. <u>102-0007-002r005</u>		
SCALES : HOR. NTS VERT.				

TYPICAL STREET
300mm – 1000mm CUT

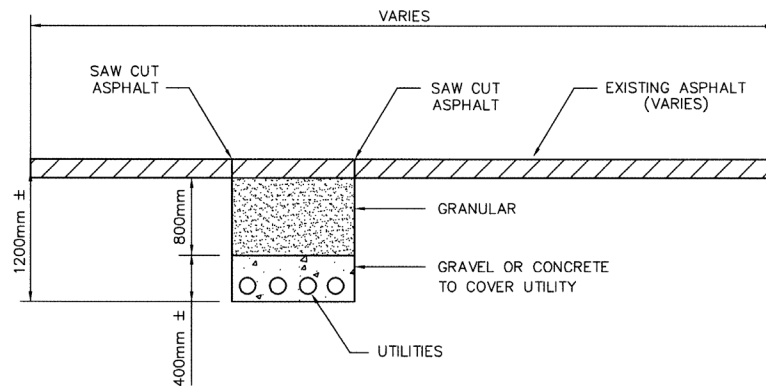


- * ASPHALT SHALL BE PLACED AT 75mm THICK OR MATCH EXISTING THICKNESS WHICHEVER IS GREATER. IF EXISTING ASPHALT IS GREATER THAN 75mm, ASPHALT MUST BE PLACED IN TWO LIFTS.
- * THE STREET BASE GRAVEL SHALL BE PLACED IN 150 MM LIFTS (MAXIMUM) AND COMPACTED TO 100 PERCENT OF STANDARD PROCTOR DENSITY AT EXISTING FIELD MOISTURE CONTENT.
- * COMPACTION TEST REPORTS MUST BE PROVIDED
REPORTS CAN BE FAXED TO 975-2971.
- * ALL EXCAVATED MATERIAL TO BE HAULED AWAY.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

REVISIONS		 City of Saskatoon Infrastructure Services Department	CHIEF ENGINEER _____ DATE _____	
1	MRH 03-12-22		UTILITIES PLACEMENT STANDARDS	ENGINEER _____ DATE _____
2	HLO 06-01-20	PLAN NO. 102-0007-003r005		
3	HLO 07-02-28			
4	REVISED DIVISION NAME 2015-DEC-01 HLO			
DRAWN BY <u>RAV</u> DATE <u>98-11-06</u>				
SCALES : HOR. NTS VERT.				

TYPICAL GRAVEL LANE

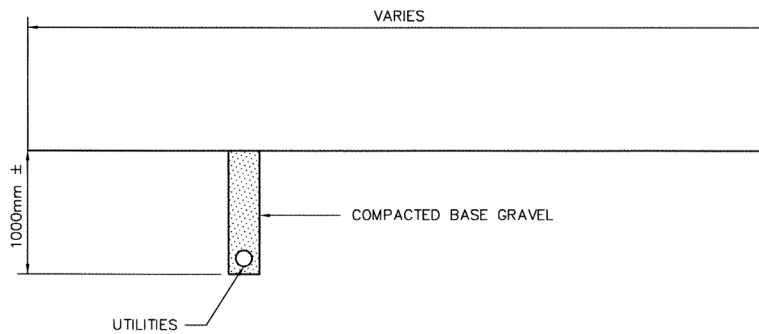

- * FILL BASE GRAVEL SHALL BE PLACED IN 150MM LIFTS (MAXIMUM) AND COMPACTED TO 95 PERCENT OF STANDARD PROCTOR DENSITY AT EXISTING FIELD MOISTURE CONTENT.
- * ALL EXCAVATION MATERIAL IS TO BE HAULED TO AN APPROVED DISPOSAL SITE AWAY FROM THE CONSTRUCTION AREA.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

R E V I S I O N S		 <p>City of Saskatoon Infrastructure Services Department</p>	CHIEF ENGINEER _____
1	CC 02-04-08		DATE _____
2	HLO 06-01-20		ENGINEER _____
3	REVISED DIVISION NAME 2015-DEC-01 HLO	DATE _____	PLAN NO. 102-0007-005r003
DRAWN BY: <u>RAV</u>		UTILITIES PLACEMENT STANDARDS	
DATE: <u>98-11-06</u>			
SCALES : HOR. NTS VERT.			

End of Specification 14001