



NOTES:

1. APPROVED BACK FLOW ASSEMBLY, APPROPRIATE FOR THE HAZARD CLASSIFICATION, TO BE INSTALLED DOWNSTREAM FROM METER SETTING. ALL NEW METER INSTALLATIONS MORE THAN THIRTY-EIGHT (38) MILLIMETRES IN DIAMETER SHALL BE FIRST APPROVED BY THE SASKATOON WATER DEPARTMENT, THROUGH THE SUBMISSION OF A METER SETTING DRAWING ACCEPTABLE TO THE SASKATOON WATER DEPARTMENT.
2. ALLOW ADEQUATE ROOM FOR TESTING OF APPROVED BACK FLOW ASSEMBLY.
3. THERE SHALL BE NO TAPS, TAKE-OFFS OR TIE-INS TO THE SERVICE PLUMBING UPSTREAM OF THE BACKFLOW PREVENTER.
4. THERE SHALL BE NO BYPASSES AROUND THE BACK FLOW PREVENTER UNLESS THE BYPASS IS FITTED WITH AN APPROVED BACK FLOW ASSEMBLY OF THE SAME TYPE.
5. APPROVED BACK FLOW ASSEMBLY, APPROPRIATE FOR THE HAZARD CLASSIFICATION MUST BE INSTALLED WITHIN 3m OF SERVICE ENTRY.
6. THE OWNER SHALL PROVIDE A SUITABLE SITE FOR THE WATER METER AT A HORIZONTAL SETTING, WITHIN 2m OF POINT OF ENTRY FOR THE WATER SERVICE CONNECTION INSIDE THE BUILDING AS PER BYLAW #7567.
7. CORPORATION COUPLING/PIPING MUST BE SECURED SO THAT THE SERVICE IS HELD FIRMLY IN PLACE.
8. METER SPACING (MIP TO MIP) 50mm (2") - 465mm (18 1/4")
9. CLEARANCE AROUND METER 500mm (20") TO SIDES 1000mm (39") IN FRONT.



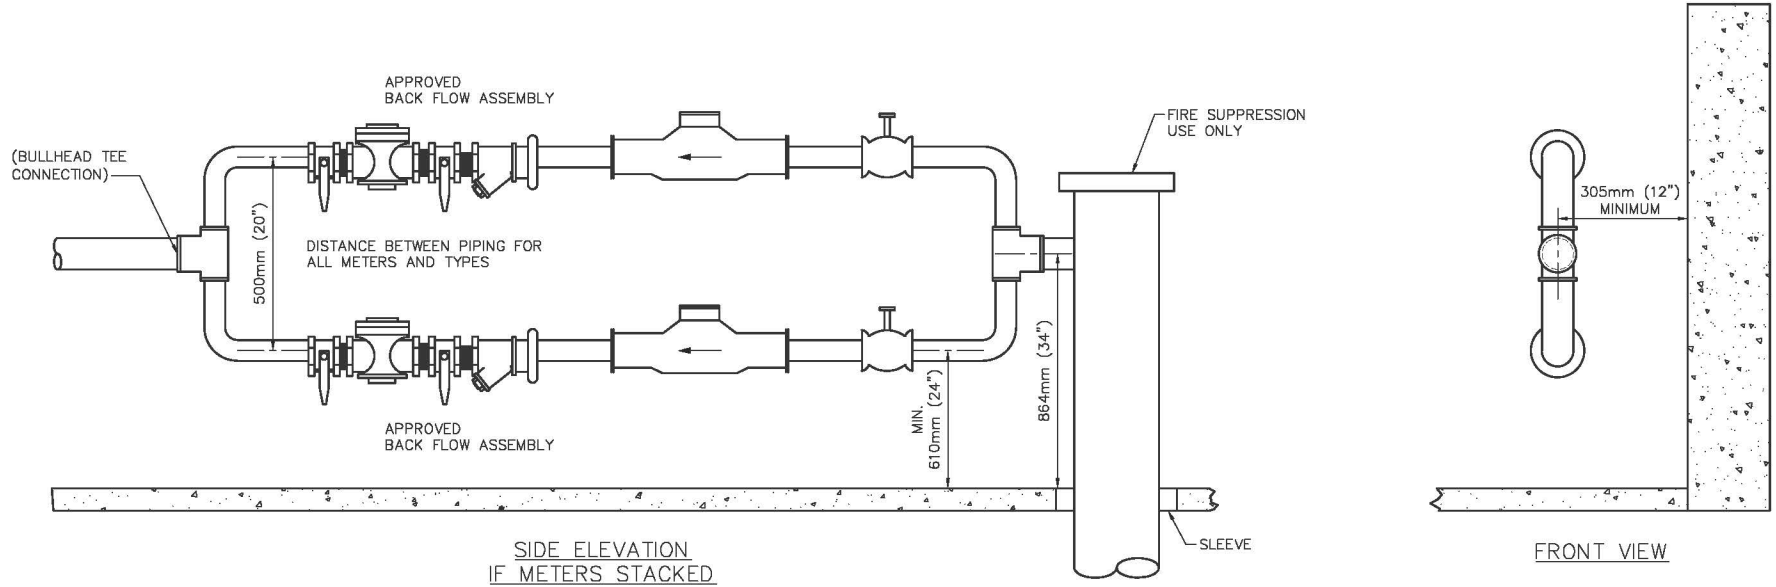

PLAN DESCRIPTION/REVISION	DATE	BY
1 ORIGINAL STANDARD SPECIFICATION DRAWING	2011-JUN-30	TPD
2 CHGD NUMBER SYSTEM & TITLE BLOCK. ADDED CORPORATION COUPLING	2015-SEP-16	CJP
3 REVISED BULLHEAD TEE IN ELEVATION VIEW	2016-MAR-10	CJP
4 DELETED PLAN VIEW & REVISED SIDE ELEVATION	2016-MAY-24	DMR
5 CHGD DWG NUMBER, TITLE BLOCK & NOTE 1. REMOVED CONTACT INFO	2016-MAY-24	DMR



**City of
Saskatoon**

TYPICAL LAYOUT FOR PARALLEL
WATER METERS
(NO BYPASS)

APPROVALS	
 SIGNATURE Christopher Richards	 SIGNATURE Russ Munro
NAME Mar 18, 2024 DATE SIGNED	NAME Mar 19, 2024 DATE SIGNED
SCALES: HOR. NTS. _____ VERT. _____	PLAN NO. 102-0013-025r005