

PUSH CONDUIT 100mm TO 150mm [4" TO 6"] INTO PORTS. USE BOTTOM PORT WHERE ONLY ONE CONDUIT ENTERS BASE

EXPANSION MATERIAL APPROVED BY ENGINEER


CONCRETE SLAB

MIN 100mm
MAX 150mm

CONCRETE BASE


- TO BE INSTALLED PLUMB
- BOLTS TO BE SQUARE WITH THE ROADWAY OR PATH

EXISTING GROUND

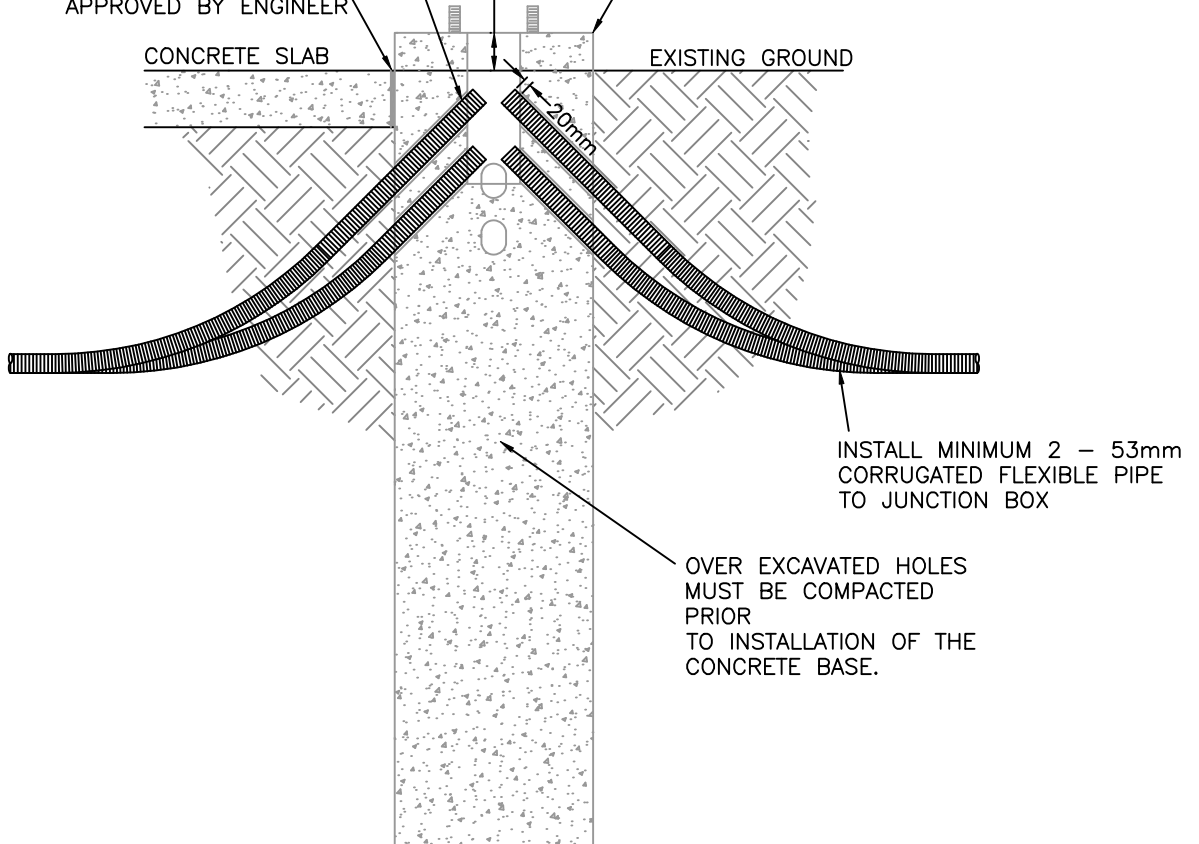

NOTE:

1. EXCAVATION FOR THE POLE BASE SHALL BE OF SUFFICIENT WIDTH TO ALLOW FOR THE MECHANICAL COMPACTION OF BACKFILL MATERIAL. ALL LOOSE MATERIAL SHALL BE REMOVED FROM THE EXCAVATION AND BACKFILLED WITH BASE AGGREGATE AS PER SECTION 03001-3.2.2 (AVAILABLE ON THE CITY'S WEBSITE).
2. ALL INSTALLATIONS MUST COMPLY WITH THE CANADIAN ELECTRICAL CODE AND TECHNICAL AUTHORITY OF SASKATCHEWAN REQUIREMENTS.

PLAN DESCRIPTION/REVISION	DATE	BY	APPROVALS	
				<p>Buchko, Michelle Digitally signed by Buchko, Michelle Date: 2026.03.24 11:46:03 -06'00'</p> <p>SIGNATURE _____</p> <p>NAME _____</p> <p>DATE SIGNED _____</p>
4 REVISED NOTES	2024-DEC-23	SCT	<p>PRE-CAST POLE BASE INSTALLATION DETAILS SPECIFICATION 12600-9</p>	<p>SCALE: _____ PLAN NO. _____</p> <p>HOR. NTC _____ 102-0016-029r004</p> <p>VERT. _____</p>
3 ADDED EXCAVATION NOTE	2018-FEB-27	AMR		
2 UPDATED INFO	2014-DEC-18	DJC		