


NOTE:

1. METER MUST BE SITUATED IN AN ACCESSIBLE LOCATION WITH NO PERMANENT FIXTURES WITHIN 500mm (20") OF THE METER.
2. APPROVED BACK FLOW ASSEMBLY, APPROPRIATE FOR THE HAZARD CLASSIFICATION MUST BE INSTALLED WITHIN 3m OF SERVICE ENTRY.
3. THE OWNER SHALL PROVIDE A SUITABLE SITE FOR THE WATER METER AT A HORIZONTAL SETTING, WITHIN 2m OF POINT OF ENTRY FOR THE WATER SERVICE CONNECTION INSIDE THE BUILDING AS PER BYLAW #7567.
4. CORP. COUPLING MUST BE SECURED SO THAT THE SERVICE IS HELD FIRMLY IN PLACE.
5. CURB COCK (CC) MUST BE BETWEEN 150mm AND 230mm (6"-9") FROM BELOW FINISHED BACK OF SIDEWALK GRADE, AND POLY PIPE MARKER LEFT IN PLACE AND EXPOSED.

WATER METER SECTION

975-2538

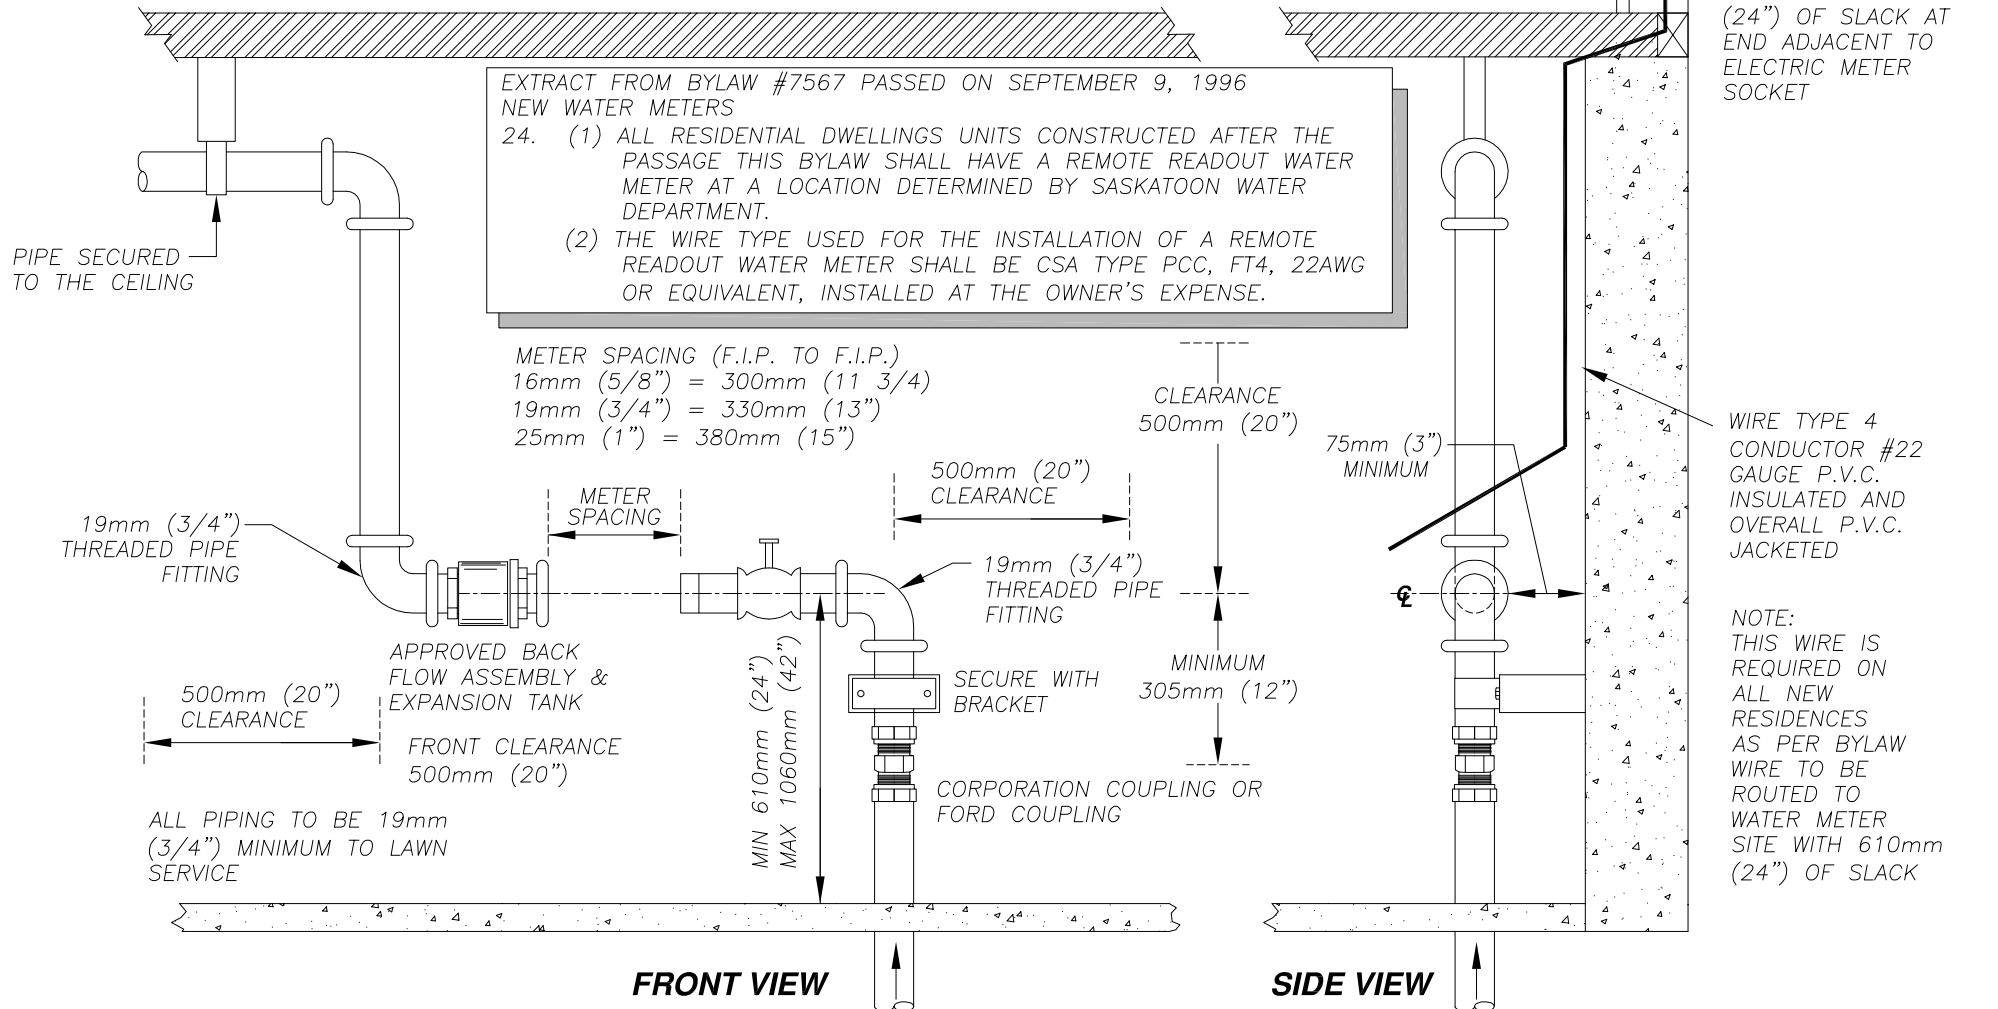

1	Plan completed by TPD June 20, 2011 - Revision: 3	2011-JUN-30	TPD
2	Changed number system, title block. Added Corporation Coupling	2015-SEP-16	C.F.
3	PLAN DESCRIPTION/REVISION	DATE	BY

SEALS & STAMPS



**City of
Saskatoon**

Transportation & Utilities Department
Saskatoon Water

WATER TREATMENT

FIGURE 1
TYPICAL WATER METER INSTALLATION
(5/8" - 1" METER)

CONTRACT NO.

SHEET NO. _____
SHEET NO. _____

PLAN NO. 701-9306-002r002

SCALES: HORIZONTAL NTS
VERTICAL NTS