


SERVICE BOX
DIMENSIONS (mm)

A	400
B	400
C	560
D	560
E	1625
F	2080
G	860
H	1120

CONTRACTOR TO VERIFY
THE ABOVE DIMENSIONS

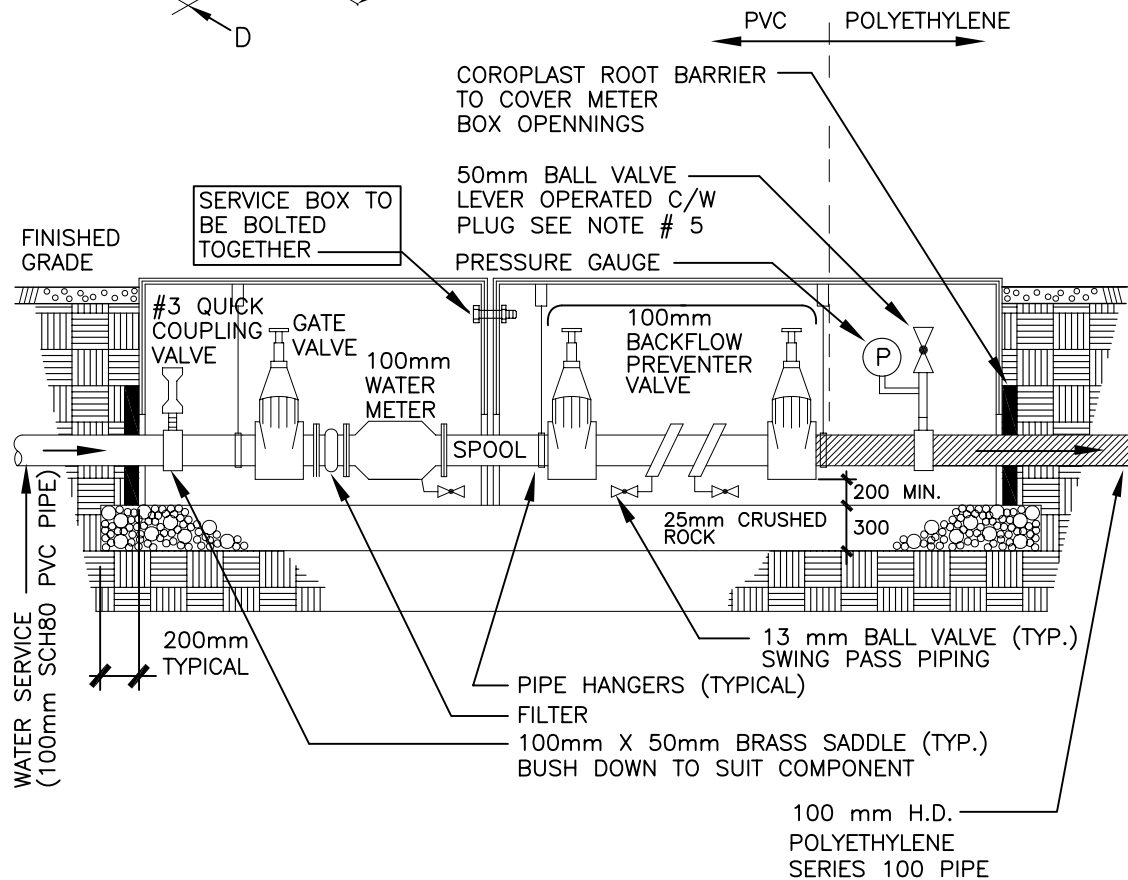

NOTE:

1. SERVICE BOXES TO BE BOLTED TOGETHER
2. ALL BOLTS USED WITHIN THE SERVICE BOXES TO BE STAINLESS STEEL.
3. INSTALL AS PER CLEARANCES SUGGESTED BY THE MANUFACTURER.
4. SERVICE BOX TO BE SUPPLIED BY OWNER
5. THREADED PVC PLUGS TO BE INSTALLED IN ALL OPEN END VALVES (ie. DRAINS & TEST COCKS ETC.).
6. INSTALL ONLY BRASS SADDLES IN SERVICE BOX.
7. MAXIMUM DISTANCE AT INLET AND OUTLET OF BOX IS 300mm TO FLANGE.
8. LENGTH OF STRAIGHT PIPE BEFORE METER IS 5 X PIPE DIA. AND 3 X PIPE DIA. AFTER METER.

701-9306-007r001