


**150mm SEPARATE CURB
CROSSING SECTION**

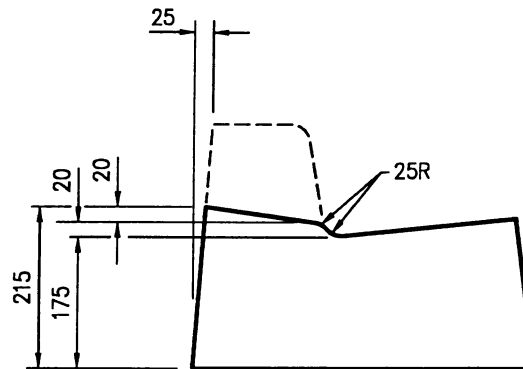

**VERTICAL CURB & GUTTER
CROSSING SECTION**

NOTES:

1. CONCRETE STANDARD:
32 MPa DURA-MIX CONCRETE
5-8% AIR AS PER SPEC.
2. COMPACTION STANDARD:
98% STANDARD PROCTOR AS PER SPEC.
3. STRAIGHT VERTICAL BACK OF CURB MAY
BE USED IN PLACE OF 25MM BATTER

REVISIONS

1	
2	
3	

DRAWN BY R. OTTENBREIT
DATE FEBRUARY 1, 1999

CHECKED BY _____
DATE _____



CITY OF SASKATOON
INFRASTRUCTURE SERVICES

SEPARATE DROPPED CURB CROSSINGS

APPROVED

GENERAL MANAGER *[Signature]* P. ENG.

ENGINEER *[Signature]*
ENGINEER

SCALES : HOR. 1:10 VERT. _____

C-3

PLAN NO. **102-0002-003r001**