

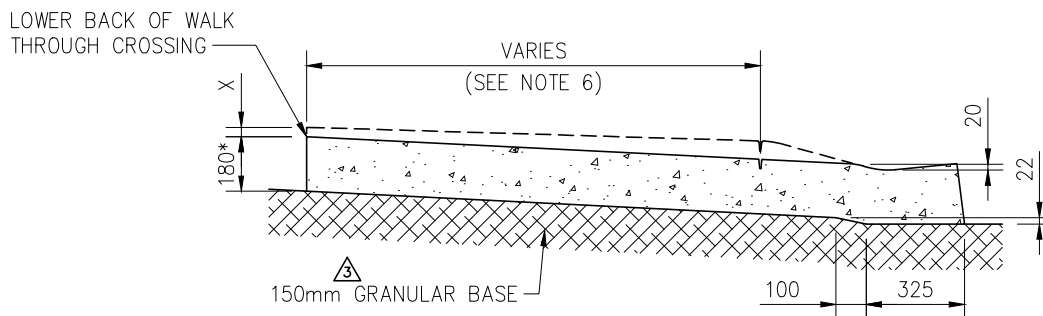


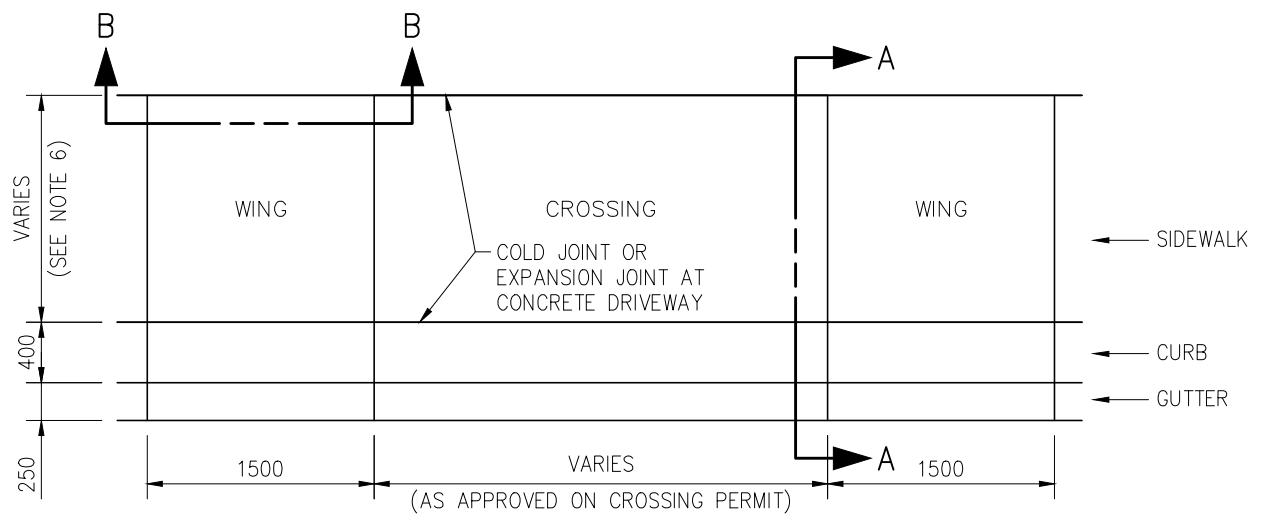

* 125mm MIN. THICKNESS
REQUIRED FOR SINGLE FAMILY
DWELLING CROSSING

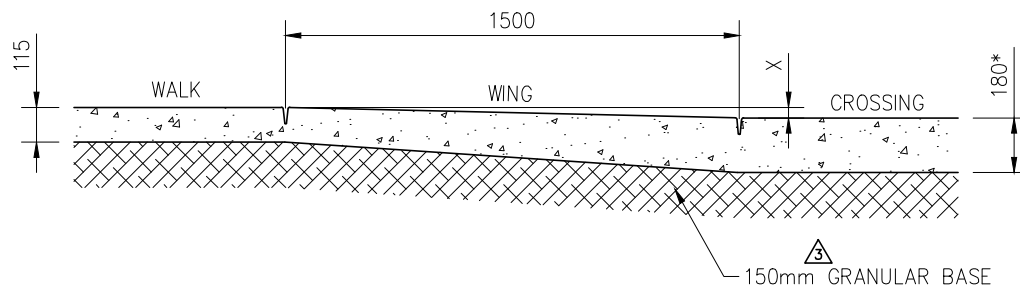

NOTES:

1. CONCRETE STANDARD:
32 MPa DURA-MIX CONCRETE
5-8% AIR AS PER SPEC.
2. COMPACTION STANDARD:
98% STANDARD PROCTOR AS PER SPEC.
3. BROOM FINISH WALK TRANSVERSELY.
BROOM FINISH CURB & GUTTER LONGITUDINALLY.
4. BROOM OVER ALL CONTROL JOINTS.
5. SPACING OF CONTROL JOINTS TO BE 1.5m.
6. SIDEWALK WIDTH VARIES ACCORDING TO STREET CLASSIFICATION REQUIREMENTS.

PLAN DESCRIPTION/REVISION			DATE	BY	APPROVALS	
1	ORIGINAL STANDARD DRAWING		1999-FEB-01	RO	 SIGNATURE Shirley Matt NAME Jan 25, 2021 DATE SIGNED	 SIGNATURE Maciej Jurkiewicz NAME Jan 25, 2021 DATE SIGNED
2	UPDATED TO ALIGN WITH THE DESIGN & DEVELOPMENT STANDARDS		2020-FEB-13	PRZ		
2	MANUAL AND POLICY C07-030 - STREET DESIGN		2020-FEB-13	PRZ		
3	UPDATED TO ALIGN WITH SIDEWALK BEST PRACTICES REPORT		2020-SEP-09	DLH		
CROSSING COMBINED SIDEWALK, ROLLED CURB & GUTTER					SCALES: HOR. AS NOTED VERT.	PLAN NO. 102-0002-012r003

