



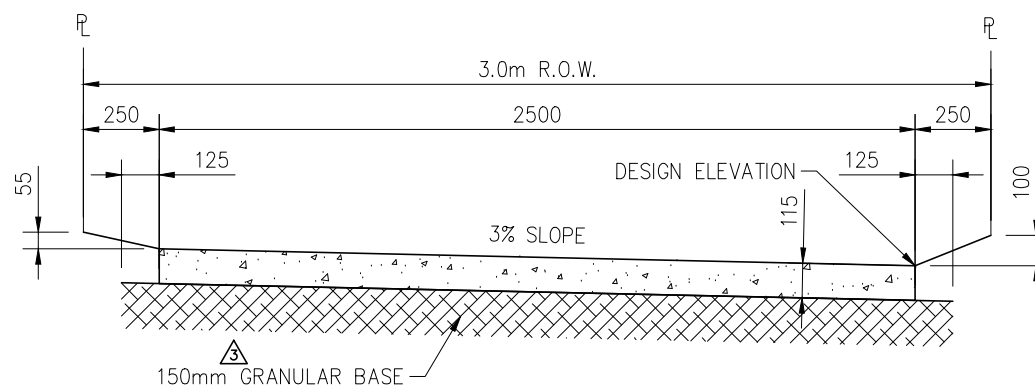

NOTES:

1. CONCRETE STANDARD:
32 MPa DURA-MIX CONCRETE
5-8% AIR AS PER SPEC.
2. COMPACTION STANDARD:
98% STANDARD PROCTOR AS PER SPEC.
3. BROOM FINISH WALK, CURB FACE & GUTTER.
BROOM OVER ALL CONTROL JOINTS.
4. SPACING OF CONTROL JOINTS TO BE 1.5m.
5. GUIDELINES FOR CONSTRUCTING WALKWAYS:
- THE CONCRETE SLAB SHOULD BE 115mm THICK & 1.5m WIDE
- THE WALKWAY SHOULD SLOPE THE SAME DIRECTION AS THE ADJACENT STREET GUTTER
6. EDGES OF WALKWAY R.O.W. ARE AT SAME ELEVATION.
7. ALTERNATE STRUCTURE MAY BE ASPHALT SURFACED, SEE PLAN 102-0002-055.
8. REMAINING R.O.W. - SEEDED TO GRASS OR COMPACTED CRUSHER DUST

PLAN DESCRIPTION/REVISION	DATE	BY
1 ORIGINAL STANDARD DRAWING	1999-FEB-01	RO
2 UPDATED TO ALIGN WITH THE DESIGN & DEVELOPMENT STANDARDS	2020-FEB-13	PRZ
2 MANUAL AND POLICY C07-030 - STREET DESIGN	2020-FEB-13	PRZ
3 UPDATED TO ALIGN WITH SIDEWALK BEST PRACTICES REPORT	2020-SEP-15	DLH

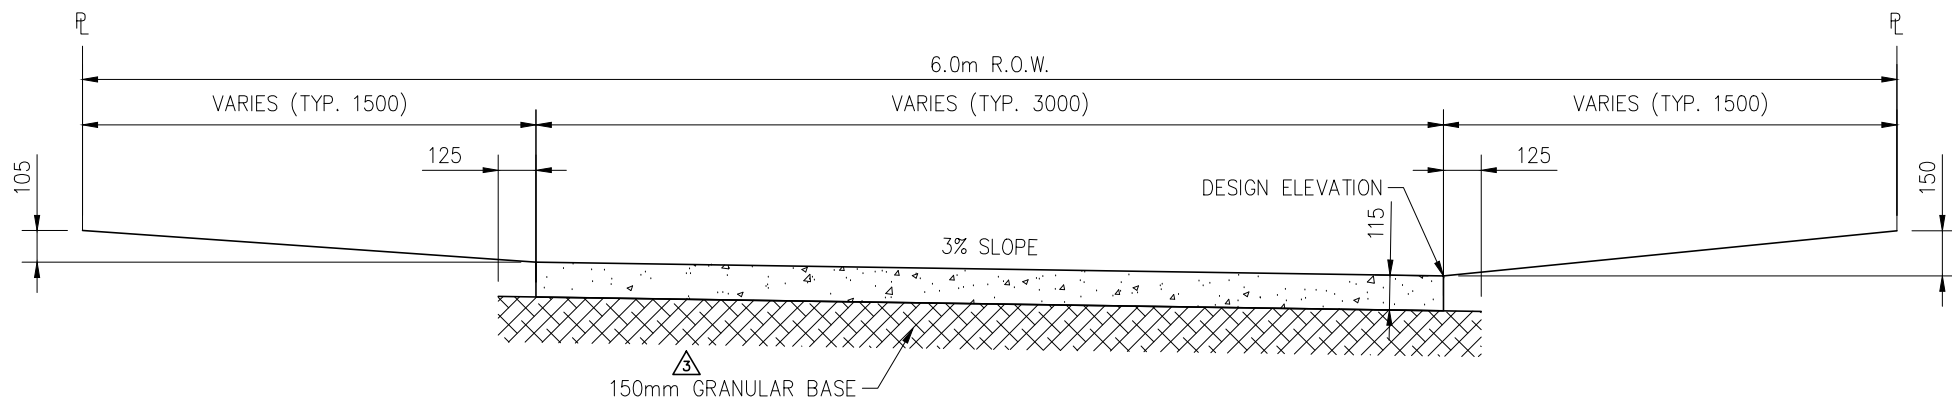

CONCRETE WALKWAY

APPROVALS

Chris Duriez

SIGNATURE
Christopher Duriez

NAME
Jan 25, 2021

DATE SIGNED

SCALES:
HOR. 1:25
VERT. 1:25

Maciej Jurkiewicz

SIGNATURE
Maciej Jurkiewicz

NAME
Jan 25, 2021

DATE SIGNED

PLAN NO.

102-0002-032r003