


TYPICAL ASPHALT CUT

0 - <300mm CUT

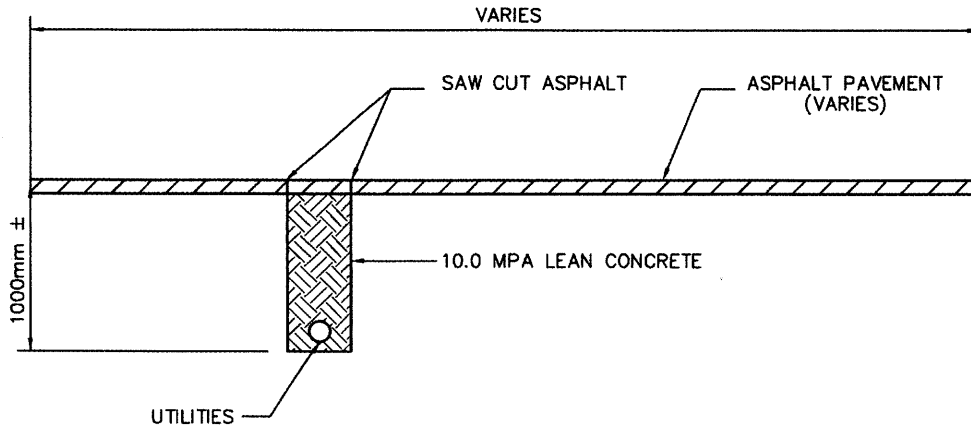

- * ASPHALT SHALL BE PLACED AT 75mm THICK OR MATCH EXISTING THICKNESS WHICHEVER IS GREATER.
- * IF EXISTING ASPHALT IS GREATER THAN 75mm, ASPHALT MUST BE PLACED IN TWO LIFTS.
- * ALL EXCAVATED MATERIAL TO BE HAULED AWAY.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

| REVISIONS | |
|----------------|--|
| 1 | MRH 03-12-22 |
| 2 | HLO 06-01-20 |
| 3 | HLO 07-02-28 |
| 4 | REVISED DIVISION NAME 2015-DEC-01 HLO |
| DRAWN BY RAV | |
| DATE 98-11-06 | |
| SCALES : | |
| HOR. NTS VERT. | |



City of Saskatoon
Transportation & Utilities Department

UTILITIES PLACEMENT STANDARDS

CHIEF ENGINEER

JAN 08 2016

DATE

ENGINEER

JAN 08 2016

DATE

PLAN NO. 102-0007-001r005