


TYPICAL STREET

300mm – 1000mm CUT

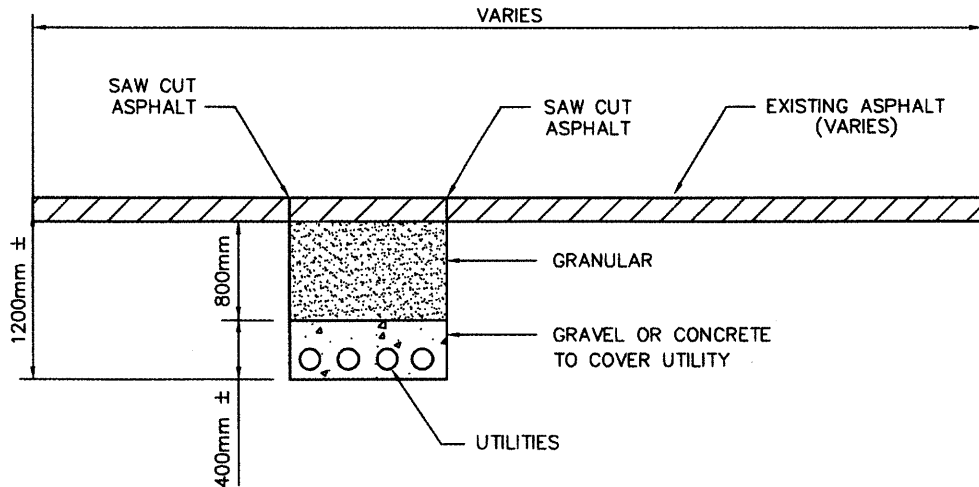

- * ASPHALT SHALL BE PLACED AT 75mm THICK OR MATCH EXISTING THICKNESS WHICHEVER IS GREATER. IF EXISTING ASPHALT IS GREATER THAN 75mm, ASPHALT MUST BE PLACED IN TWO LIFTS.
- * THE STREET BASE GRAVEL SHALL BE PLACED IN 150 MM LIFTS (MAXIMUM) AND COMPACTED TO 100 PERCENT OF STANDARD PROCTOR DENSITY AT EXISTING FIELD MOISTURE CONTENT.
- * COMPACTION TEST REPORTS MUST BE PROVIDED REPORTS CAN BE FAXED TO 975-2971.
- * ALL EXCAVATED MATERIAL TO BE HAULED AWAY.

1. ALL UTILITY CONSTRUCTION AND MAINTENANCE ACTIVITY INVOLVING EXCAVATION IN A CITY STREET OR LANE RIGHT-OF WAY MUST BE REPORTED TO THE CONSTRUCTION & DESIGN DIVISION CITY OF SASKATOON.
2. REPAIRS/RESTORATION OF THE STREET/LANE SURFACE SHALL BE DONE AS SHOWN.

| REVISIONS | |
|----------------------------|--|
| 1 | MRH 03-12-22 |
| 2 | HLO 06-01-20 |
| 3 | HLO 07-02-28 |
| 4 | REVISED DIVISION NAME 2015-DEC-01 HLO |
| DRAWN BY <u>RAV</u> | |
| DATE <u>98-11-06</u> | |
| SCALES : HOR. NTS VERT. | |



City of Saskatoon
Transportation & Utilities Department

UTILITIES PLACEMENT STANDARDS

[Signature]
CHIEF ENGINEER
DATE JAN 08 2016

[Signature]
ENGINEER
DATE JAN 08 2016

PLAN NO. 102-0007-003r005