



1050mm MANHOLE BARRELS AND CONCENTRIC CONE TO BE USED EXCLUSIVELY FOR REHABILITATION WORK ON EXISTING 1050mm MANHOLE BASES.

FOR NEW INSTALLATIONS AND RECONSTRUCTION SEE COS STANDARD SPECIFICATIONS.

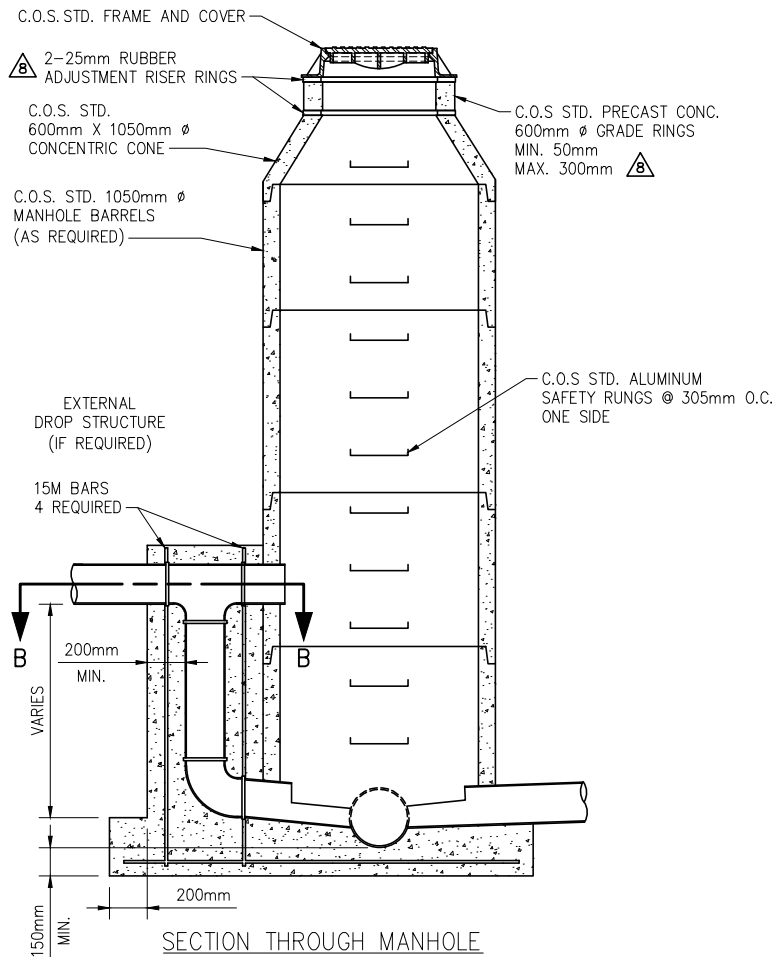


SECTION B-B

NOTES:

- DROP STRUCTURE REQUIRED WHEN CROWN OF INLET PIPE IS 0.75m OR MORE ABOVE CROWN OF OUTLET PIPE.
- USE 4 - 15M BARS PLACED AS SHOWN WHEN EXTERIOR DROP SECTION IS 1.5m OR MORE.
- ALL CAST IN PLACE CONCRETE TO BE 35MPa SULPHATE RESISTANT. ALL GROUT TO BE NON-SHRINK, TYPE HS SULPHATE RESISTANT, CEMENTITIOUS GROUT.
- PLACE 10M BARS AT 200mm O.C. EACH WAY IN BASE OF MANHOLES OVER 4.5 m DEEP.
- ALL PRECAST CONCRETE SECTIONS SHALL BE MANUFACTURED IN ACCORDANCE WITH ASTM SPECIFICATION C478.
- SAFETY PLATFORMS AS PER CITY OF SASKATOON STANDARD SPECIFICATIONS SHALL BE INSTALLED IN ALL MANHOLES WITH DEPTHS GREATER THAN 6.0m.
- SAFETY PLATFORMS SHALL BE INSTALLED IN SUCH A MANNER SO THAT NO VERTICAL FALL DISTANCE EXCEEDS 5.0m OR IS LESS THAN 2.4m.
- MANHOLE RUNGS SHALL BE ORIENTED SUCH THAT THEY DO NOT INTERFERE WITH THE INCOMING PIPE.
- PVC CHANNELING SHALL BE SEAMLESS FOR STRAIGHT THROUGH BASES.
- PIPE TO MANHOLE CONNECTIONS SHALL BE WATERTIGHT.
- TAPERED RUBBER ADJUSTMENT RISER RINGS ARE REQUIRED ON CATCH BASINS AND MANHOLES THAT ARE OFFSET FROM THE CENTER OF THE ROAD.

CHANNELIZATION DETAILS FOR INTERIOR DROP OF LESS THAN 0.75m

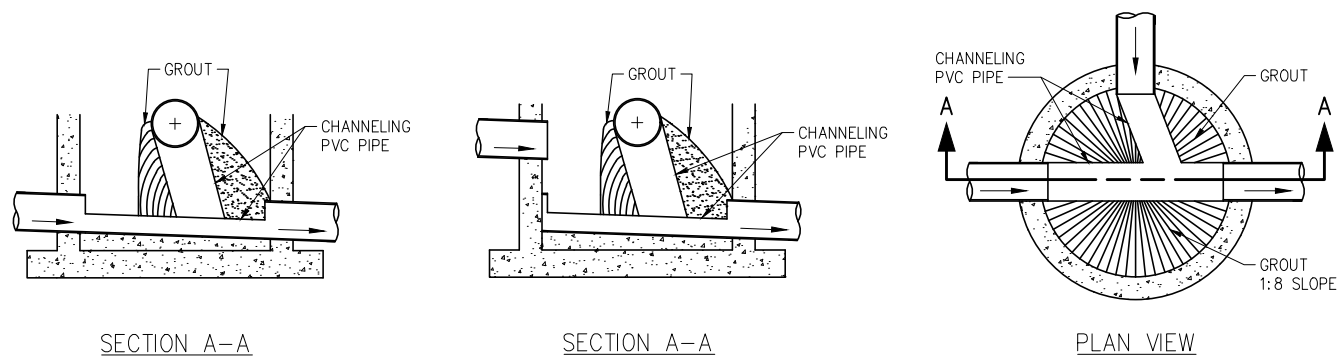

SECTION A-A

SECTION A-A

PLAN VIEW

PLAN DESCRIPTION/REVISION	DATE	BY	APPROVALS	
1 RENUMBERED FROM 08010-D3A	2000-AUG-30	RO	<p>STANDARD 1050mm MANHOLE FOR 200mm TO 525mm SANITARY SEWERS FOR REHABILITATION WORK ONLY</p>	<p>SIGNATURE <i>Jeff P D Thomson</i> NAME Jeff P D Thomson DATE SIGNED Jan 27, 2021</p> <p>SIGNATURE <i>Maciej Jurkiewicz</i> NAME Maciej Jurkiewicz DATE SIGNED Jan 27, 2021</p> <p>SCALE: HOR. 1:40 VERT. _____ PLAN NO. 102-0011-004r008</p>
2	2006-JAN-20	HLO		
3	2007-JAN-22	HLO		
4	2012-JAN-05	HLO		
5 NOTE 3 - 35MPa CONC., NOTES 6&7	2014-DEC-12	MJ		
6 ADDED GROUT AROUND PIPES AT MANHOLE BASE AND NOTES 8 & 9	2015-NOV-26	HLO		
7 REMOVE GROUT AROUND PIPES AT MANHOLE BASE, REVISED NOTE 3, AND ADDED NOTE 10	2017-JAN-25	HLO		
8 ADDED NOTE 11, GRADE RING MIN., AND RUBBER ADJ. RISER RINGS	2021-JAN-07	DLH		