
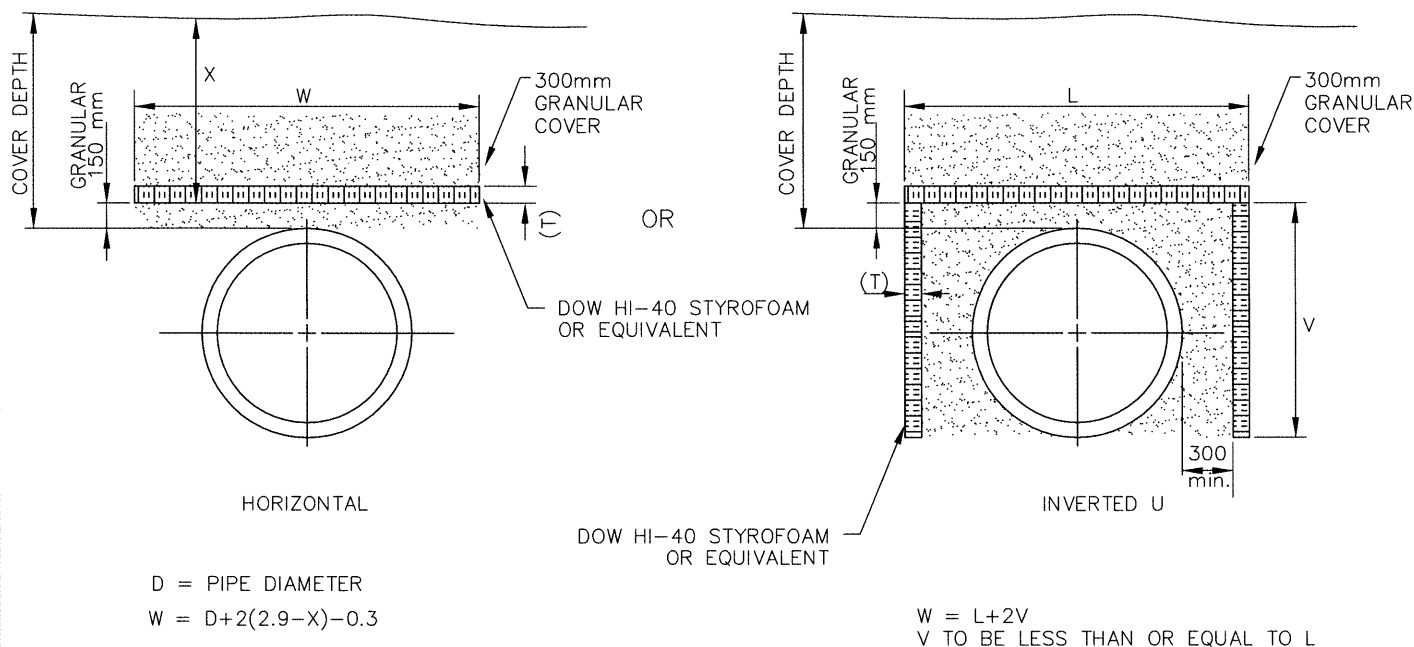


COVER DEPTH m	THICKNESS (T) mm (IN)
1.1 - 1.4	90 (3.5)
1.4 - 1.7	75 (3.0)
1.7 - 2.0	75 (3.0)
2.0 - 2.3	50 (2.0)
2.3 - 2.6	40 (1.5)
2.6 - 2.9	40 (1.5)
BELOW 2.9	-



NOTES:

1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE NOTED
2. APPLICABLE WHEN USING FILLCRETE OR GRANULAR BACKFILL
3. COMPRESSION STRENGTH OF STYROFOAM: 275 KPa (min)

PLAN DESCRIPTION/REVISIONS		 City of Saskatoon Infrastructure Services Department	 CHIEF ENGINEER JAN 08 2016
4			
3	CLARIFY D = PIPE DIAMETER 2015-DEC-01 HLO		
2	RV UPDATE SPECS. 2012-NOV-20		
1	JMH 06-01-25		
DRAWN BY MJ DATE 2003-04-02		TYPICAL PIPE INSULATION	 ENGINEER JAN 08 2016
SCALE : HOR. NTS VERT.			