


DIA	A	B	C	D
300	600	400	300	400
350	700	475	350	475
400	800	550	400	550

NOTE:
CONCRETE SHALL BE 20MPa AT
28 DAYS, AND BE SULPHATE RESISTANT

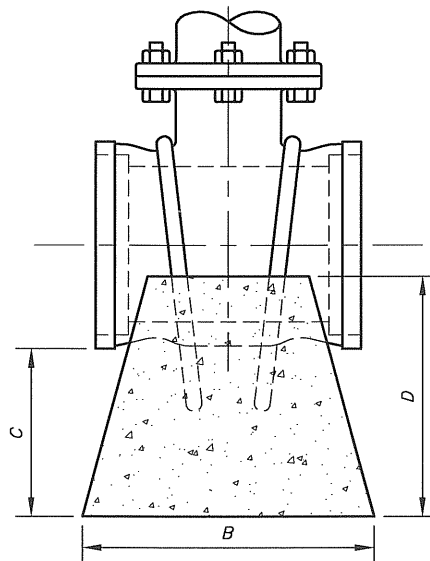

REVISIONS

1	HLO 2007-01-22
2	ADDED 6 MIL POLY REQUIREMENT HLO 2010-12-14
3	

DRAWN BY RAM
DATE 2004-09-29

CHECKED BY _____
DATE _____



**City of
Saskatoon**
Infrastructure Services Department

VALVE ANCHORING DETAILS FOR 300 MM & LARGER VALVES

APPROVED

[Signature]
GENERAL MANAGER P. ENG.

[Signature]
ENGINEER

SCALES :
HOR. 1:10

PLAN NO. 102-0012-010r003