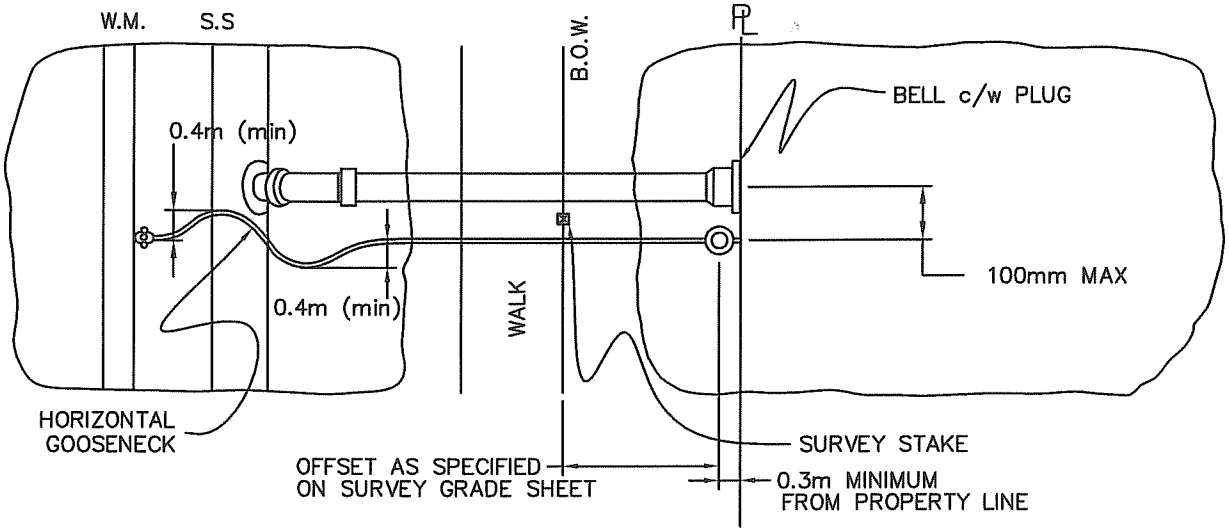

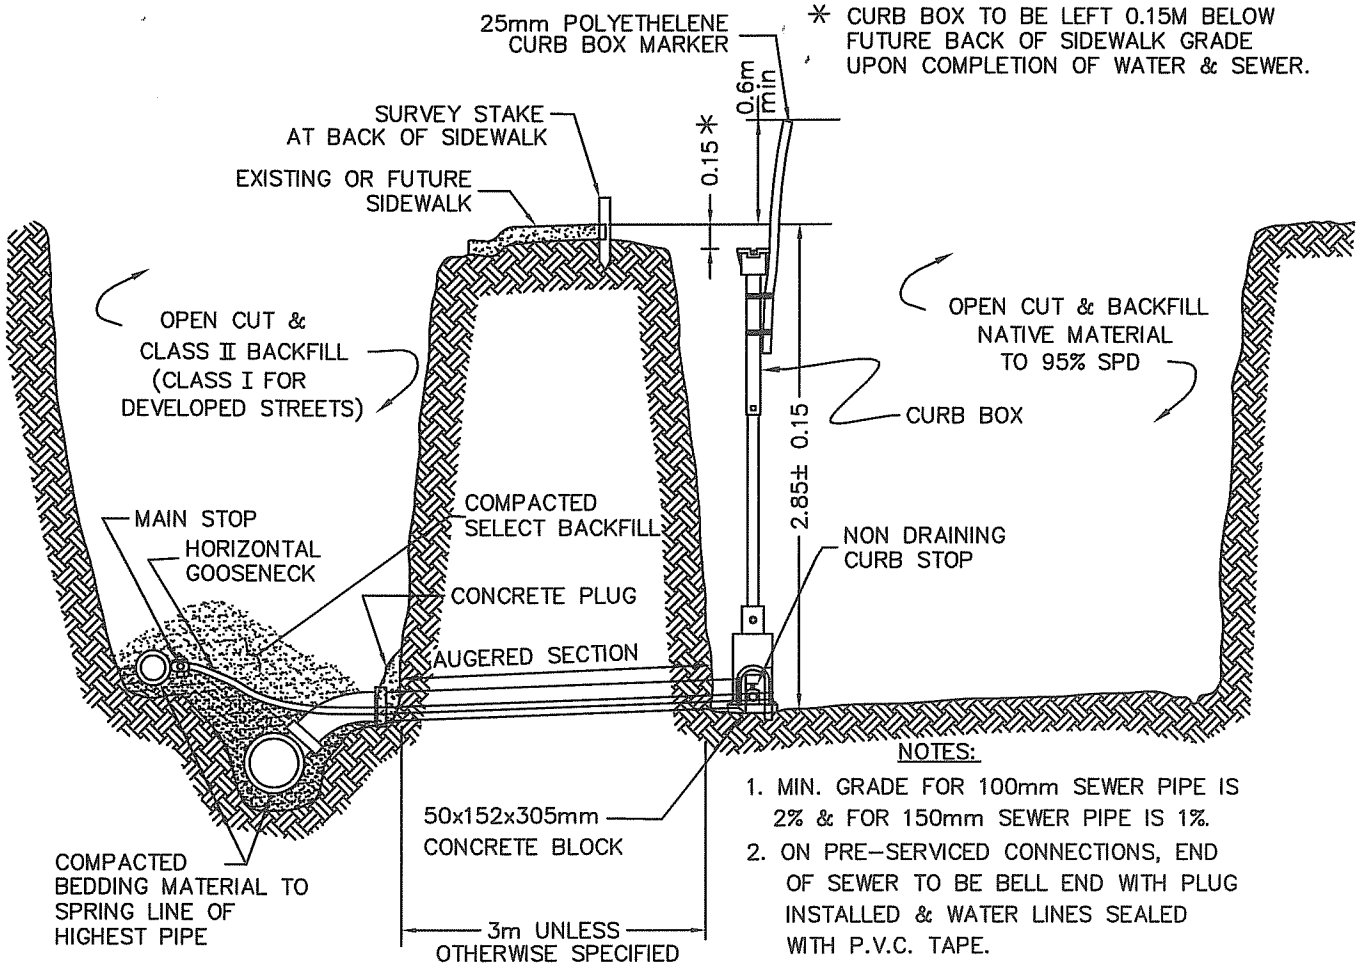

NOTES:

1. MIN. GRADE FOR 100mm SEWER PIPE IS 2% & FOR 150mm SEWER PIPE IS 1%.
2. ON PRE-SERVICED CONNECTIONS, END OF SEWER TO BE BELL END WITH PLUG INSTALLED & WATER LINES SEALED WITH P.V.C. TAPE.

REVISIONS		
1	RBY	02/07/2000
2	JMH	22/01/2003
3	JMH	30/04/2003
4	ADDED NOTES REGARDING CURB BOX HEIGHT & MARKER HLO	10/12/2009
5	REVISED CURB BOX HEIGHT AND BACKFILL MATERIAL NOTES HLO	03/01/2013

DRAWN BY G.R.F.

DATE MAR. 30, 1992

City of Saskatoon
Infrastructure Services Department

TYP. SEWER & POLYETHELENE WATER SERVICE CONNECTION

APPROVED

GENERAL MANAGER P. ENG.

ENGINEER

ENGINEER

SCALES : HOR. NTS VERT.

PLAN NO. 102-0013-001r005