



CENTRE DUCTS IN JUNCTION BOX.
 IF THE JUNCTION BOX IS CLOSEST TO THE CABINET
 INSTALL 2-100mm 90° ELBOWS TO CABINET IN CENTRE
 AND ALL OTHER DUCTS AROUND IT. SEE DWG. 102-0016-033
 ATTACH ALL DUCTS TOGETHER WITH DUCT TAPE OR ZIP TIES.

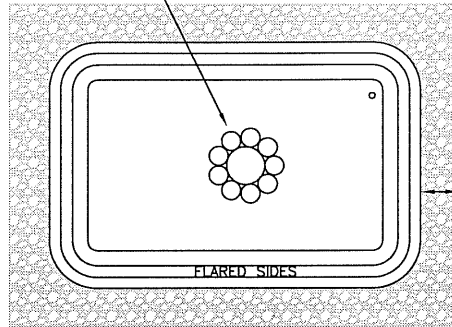

TOP VIEW

NOTES:

1. CONDUIT TO BE CUT PARALLEL TO SURFACE
2. CLEAN PEA GRAVEL SHALL BE SUFFICIENTLY COMPACTED TO PREVENT SHIFTING OF THE JUNCTION BOX

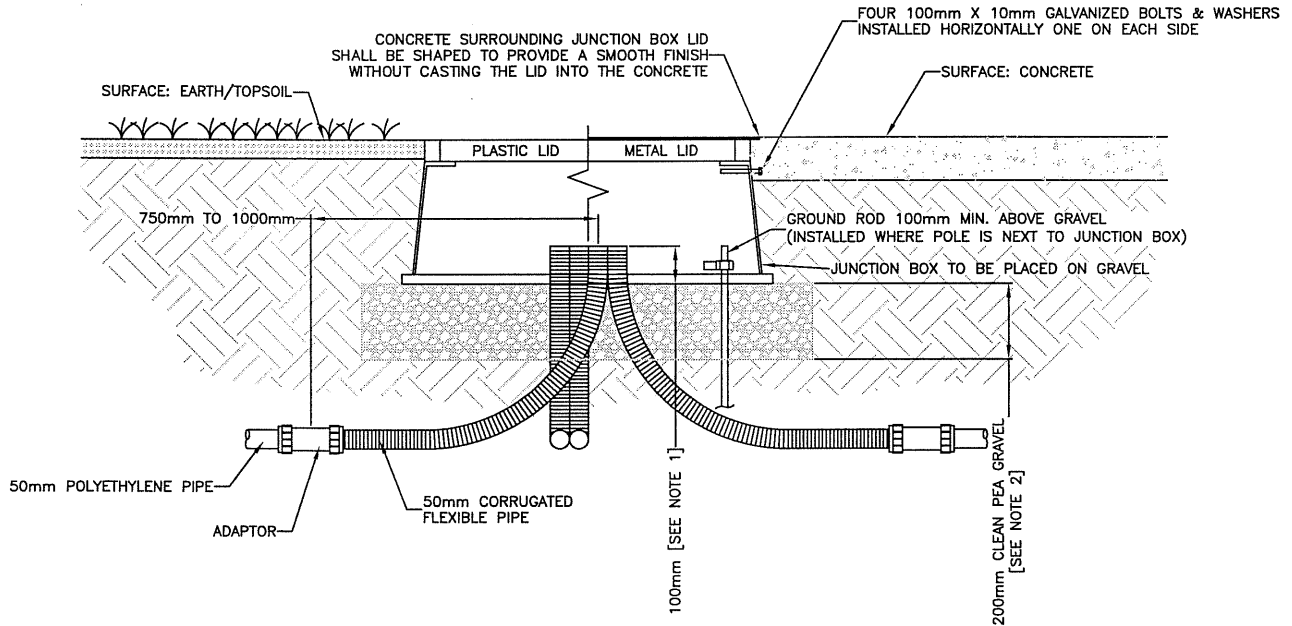

FRONT VIEW

PLAN DESCRIPTION/REVISIONS	
4	REVISED NOTES
3	REVISED DUCT LAYOUT
2	
1	
DRAWN BY <u> RPH </u>	
DATE <u> 2003-APR-28 </u>	
SCALE : HOR. <u> NTS </u> VERT. <u> </u>	



City of Saskatoon
 Infrastructure Services Department

JUNCTION BOX
 INSTALLATION DETAILS
 SPECIFICATION 12600-7

APPROVED	
	MAR 19, 11
GENERAL MANAGER	
ENGINEER	
ENGINEER	
PLAN NO.	102-0016-019r004